



KOHLEN CONCRETE PRODUCTS, INC.
Since 1952

1126 Old Carlyle Rd, Germantown, IL 62245 | Phone: 618-523-4266 | Belleville Phone: 618-277-2120 | Fax: 618-523-4751 | www.kohlenconcrete.com

PRECAST CONCRETE LIFT STATION
FOR INSTALLATION BEFORE OR AFTER SEPTIC SYSTEMS & AERATION SYSTEMS


- Contact our office for applications and pricing.
 - For installations before septic systems a 2" sewage pump should be used.
 - For installations following septic systems a 1 1/2" effluent pump is used.
- C-56 3/4" sealant is used to seal the joints. 1 roll per joint.
- Inlet piping should be installed at the joint of the base to provide adequate liquid depth.
- Outlet piping should be located at the appropriate location to provide drainage from the lift station.
- The top of the lid should be 5" above the final grade to prevent surface water entry to unit.

AVAILABLE ACCESSORIES

(Priced on Request)

- Sewage Pumps
- Effluent Pumps
- High Level Alarms
- Check Valves
- Joint Sealant
- PVC Piping
- Electrical Connection to Facility

WEIGHT:	
42" LID	350 LBS
22" SECTION	650 LBS
12" SECTION	325 LBS
BASE	1000 LBS

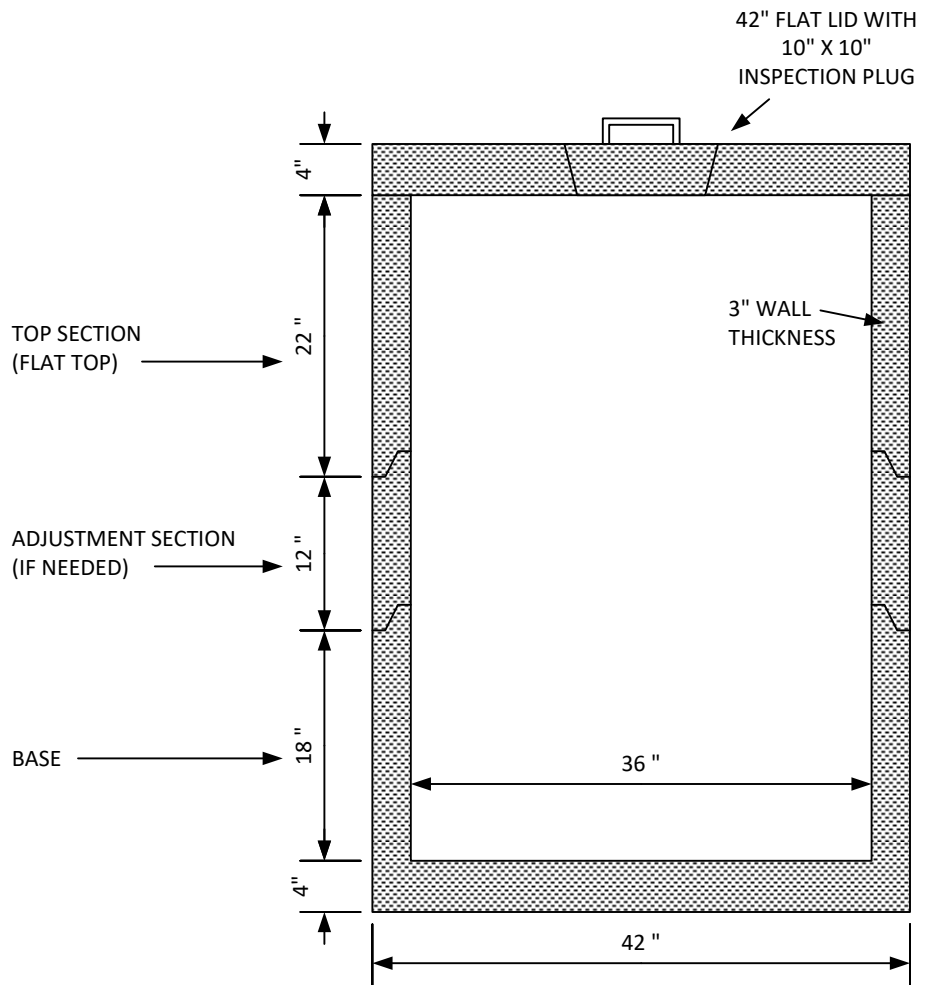

* STORAGE CAPACITY IS 52 GALLONS PER FOOT